





## CHULA VISTA FIRE DEPARTMENT

### FIRE PREVENTION DIVISION

#### Detail A - Single Occupant Building

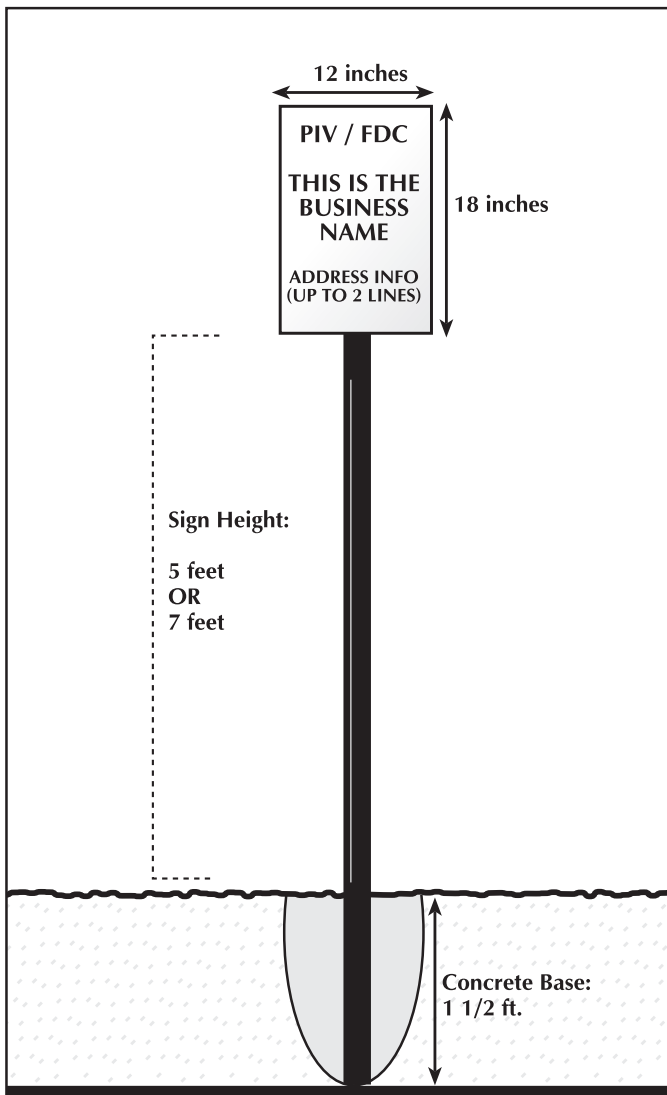

#### Detail B - Multiple Occupant Building

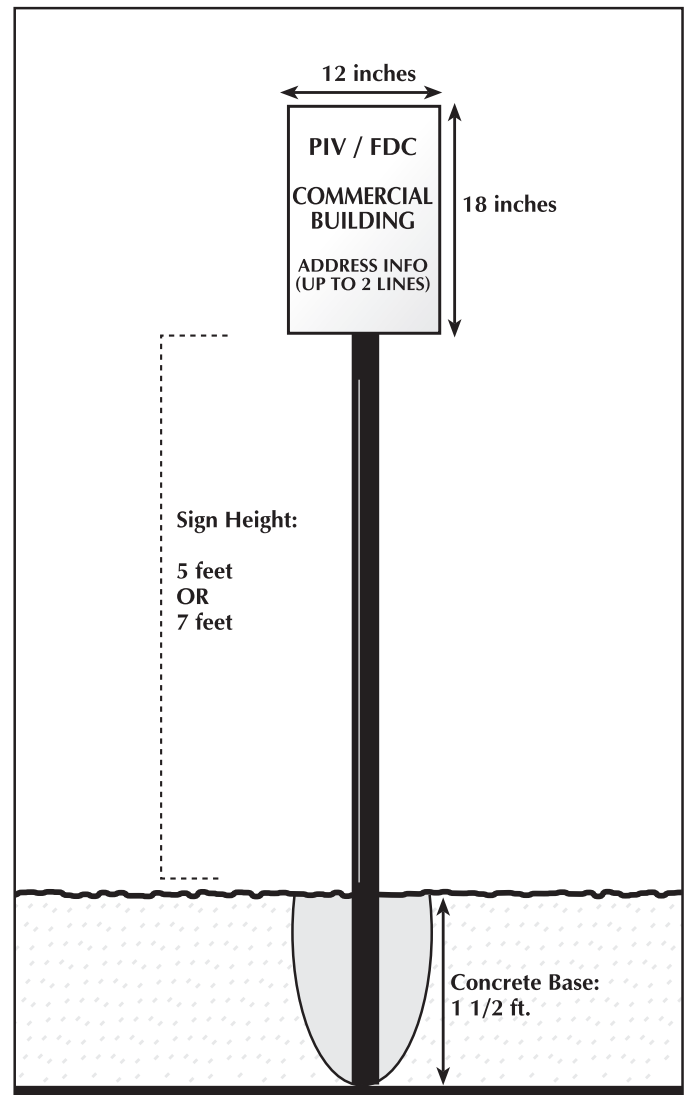

#### Sign Specifications

1. Measurements MUST be exact and will be subject to a field inspection
2. Sign must be .080 gauge aluminum
3. Holes and radii must adhere to CalTrans standards
4. Sign must be diamond grade
5. Protective overlay film on sign
6. Sign support pole: schedule 40, 2-inch galvanized pipe
7. Sign must be buried in concrete base 1 1/2 feet deep
8. Signage letter height:
  - PIV/FDC and business name = 1 1/4 inches tall
9. A blue reflective marker must be in place to identify location

